


# 2011年3月17日 15:00~19:00 計画停電中の冷凍庫内温度グラフ

温度・湿度グラフ

2011/03/18 10:05'40

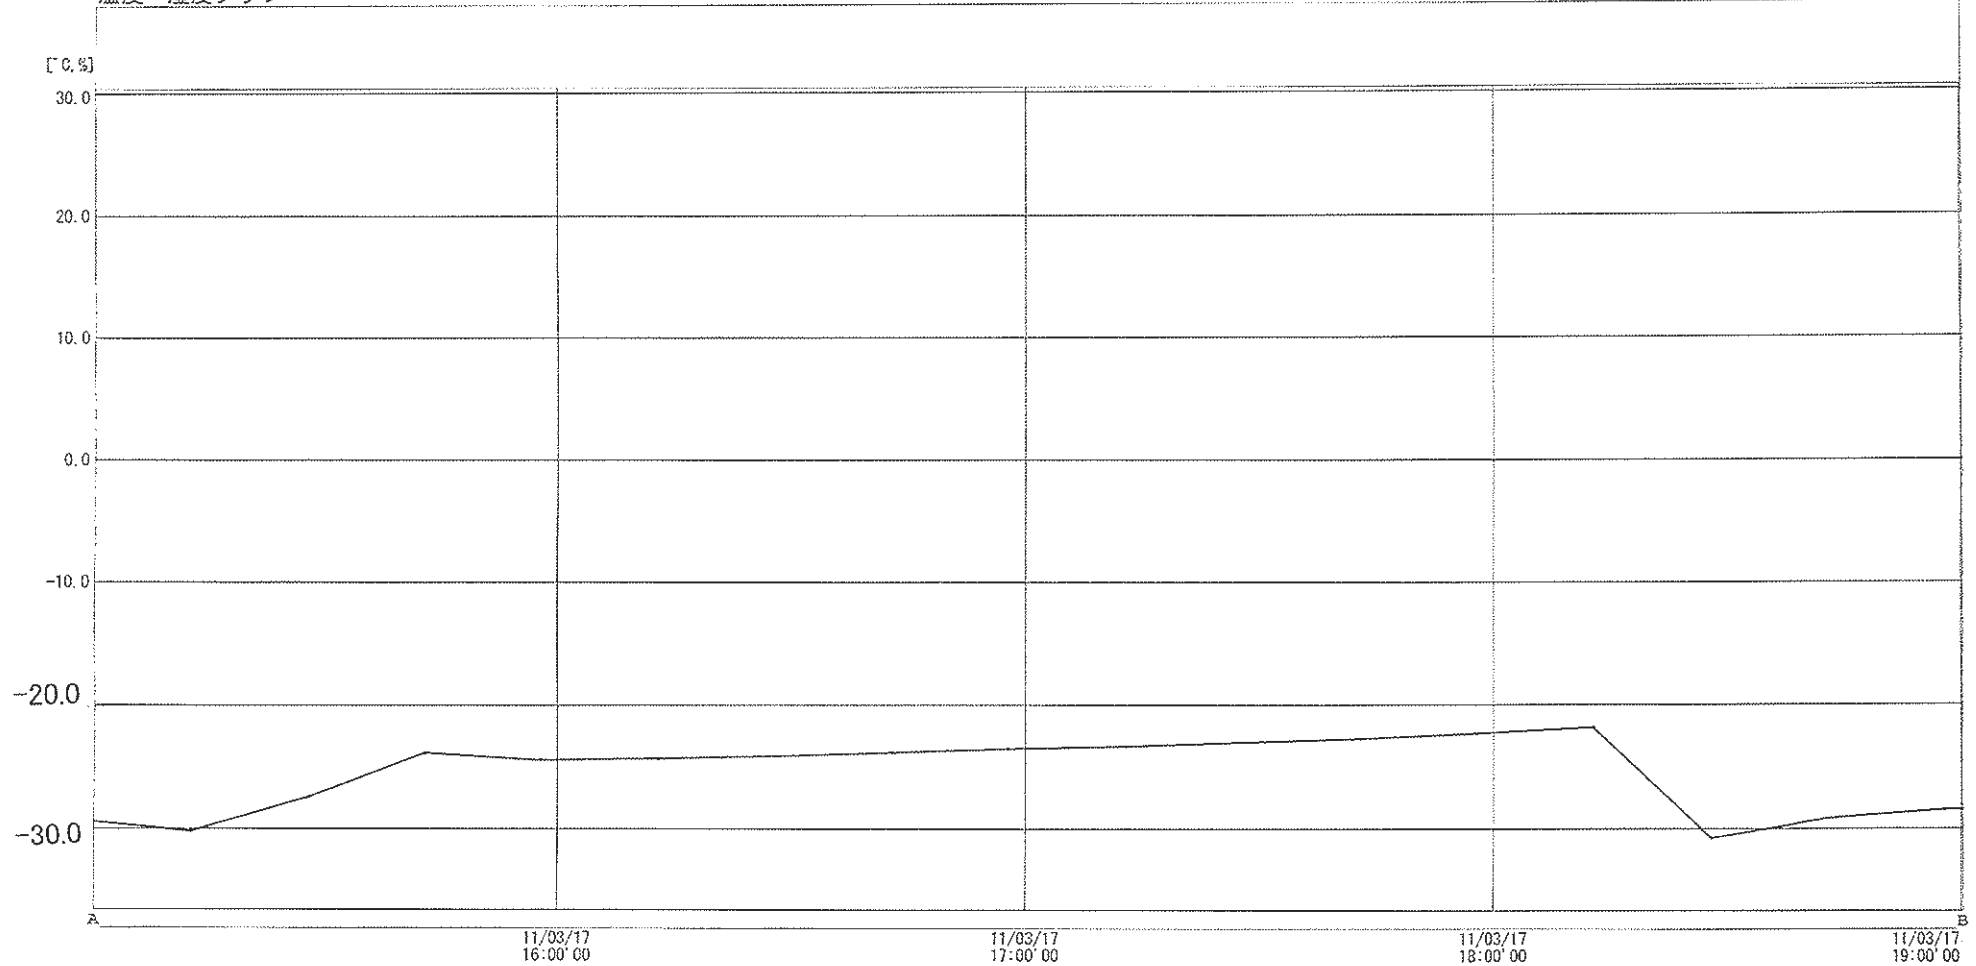

ch	Name	Intvl.	Sample	Cur. A	Cur. B	A<->B	Max.	Min.	Avg.	Unit
1	OFFICE 1	15min.	80	-30.2	-28.1	2.1	-21.8	-30.8	-25.2	°C
Cur. A Date : 2011/03/17 15:00'29							Data Range 2011/03/17 15:00'29-2011/03/17 19:00'16			
Cur. B Date : 2011/03/17 19:00'16							Calc. Range 2011/03/17 15:00'29-2011/03/17 19:00'16			
diff. A-B : Oday 03:59'47										